

# MODEL TS-5



- BLUE 2 INCH SQUARE PUSHBUTTON
- ADA SYMBOL
- MOMENTARY ACTION SWITCH
- S.P.D.T. CONTACTS RATED 10A.@35 VDC
- SWITCH TERMINATED WITH 10" LEADS
- 1/2 INCH RED LED OPERATES ON 12 OR 24 VDC
- SWITCH ILLUMINATED WITH HI-BRIGHTNESS LED, OPERATES ON 12 OR 24 VOLTS AC OR DC
- SWITCH MOUNTED ON SINGLE GANG 430 STAINLESS STEEL WALLPLATE
- SWITCH DEPTH 2.5" BEHIND PLATE
- CONFORMS TO U.L. STANDARD 294 FOR ACCESS CONTROL, U.L. FILE NUMBER SA32686



**ALARM CONTROLS CORPORATION**  
19 BRANDYWINE DRIVE DEER PARK, NY 11729

1 631 586-4220 1 800 645-5538

WWW.ALARMCONTROLS.COM EMAIL INFO@ALARMCONTROLS.COM


# INSTALLATION INSTRUCTIONS

## MODELS TS-2, TS-3, TS-4, TS-5



U.L. FILE SA32686 CONFORMS TO U.L. STANDARD 294 FOR ACCESS CONTROL

### REAR VIEW OF PLATE

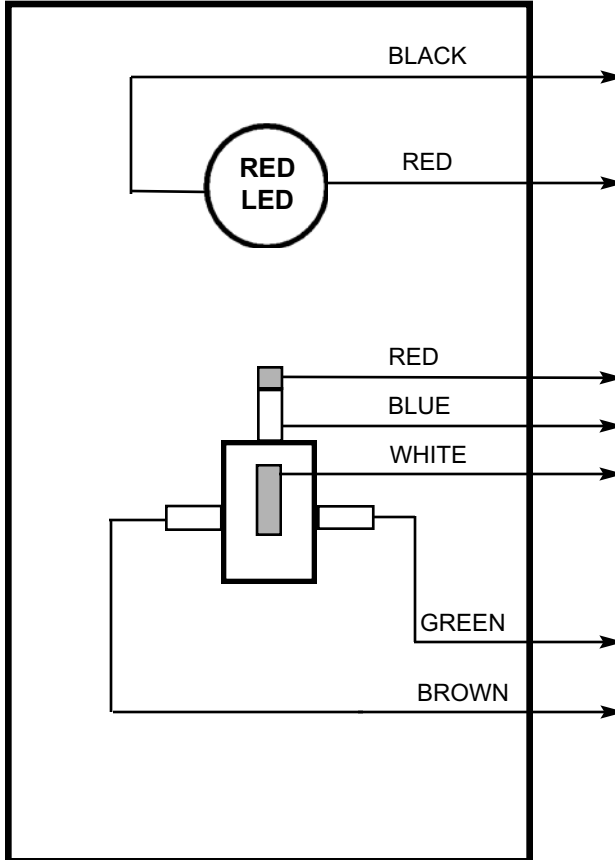

**RED LED 12/24 VOLTS DC**  
**RED LED ONLY ON TS-3, TS-5**

**LED CURRENT RATING**  
 9 MA. @ 12 VDC, 19 MA. @ 24 VDC  
**NEGATIVE ( BLACK ) LEAD**

**POSITIVE ( RED ) LEAD**

**SWITCH CONTACTS**  
**RATED 2A. @ 12 - 28 VDC**  
**N/C ( RED ) LEAD LOWER LUG**  
**N/O ( BLUE ) LEAD UPPER LUG**  
**COM ( WHITE ) LEAD TOP LUG**

**INTERNAL LED**  
**LED ( GREEN ) NEGATIVE LEAD**  
**LED WILL OPERATE ON 12/24 VDC**  
**LED ( BROWN ) POSITIVE LEAD**

**LED CURRENT DRAW**  
 4 MA. @ 12 VDC  
 15 MA. @ 24 VDC

*LED OPERATES ON 12/24 VDC*

**MOUNT WALLPLATE IN A VERTICAL POSITION**  
**MODELS TS-2, TS-3, TS-4 & TS-5 SHOULD BE MOUNTED IN A 2.5 INCH DEEP ELECTRICAL BOX**



**ALARM CONTROLS CORPORATION**

**19 BRANDYWINE DRIVE P.O. BOX 280**

**DEER PARK, NY 11729**

**PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500**

**WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM**